



EVCO EVLINK ACCESS INSTRUCTIONS


NOTE: CASE MUST BE POWERED ON TO ACCESS THE CONTROLLER.

- 1) Download the EVLINK app to your smart phone by scanning the appropriate QR code.

SCAN ONE TO DOWNLOAD APP FOR CONTROLLER




- 2) Open the EVLINK app. Locate your case among the list of Bluetooth devices. Killion cases will start with **KII** followed by the ID number for the controller. Select the device from the list.

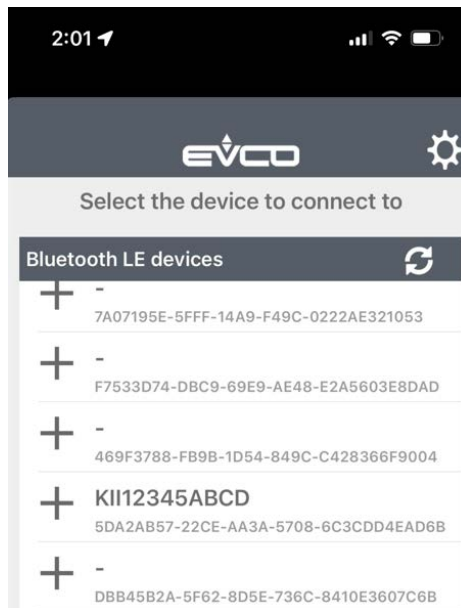


- 3) Enter **426** for the device password when prompted.

4) The next screen shows when you have connected to the controller:

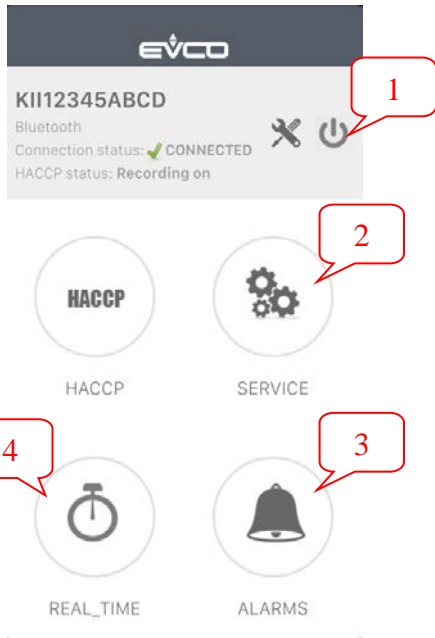

1.	Disconnect from controller.
2.	View/Change all controller settings (service technician level access only).
3.	View errors/alarms.
4.	View current case status, initiate manual defrost, and adjust setpoint.

5) To change basic settings, select the REAL_TIME button in the lower left (Option 4 shown above). You will see the screen below:

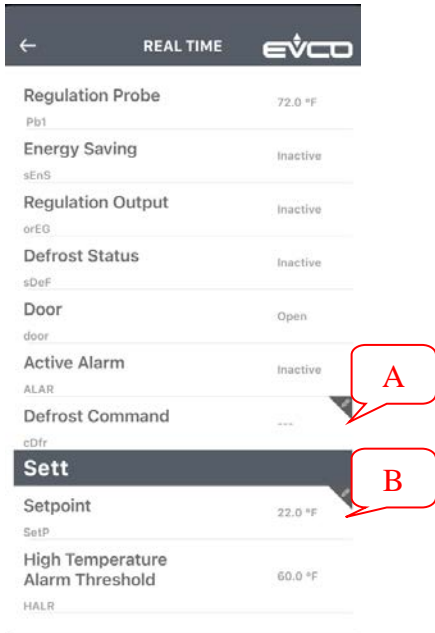

A	To initiate a manual defrost cycle: <ul style="list-style-type: none"> - Select Defrost Command. - Select Start from the list of options. - Press the CONFIRM button in the lower right of the window.
B	To change the current case setpoint: <ul style="list-style-type: none"> - Select Setpoint - Scroll through the values to find your new setpoint setting - Press the CONFIRM button in the lower right of the window.

6) When you are done viewing/changing settings, select the ← icon at the top left, then the ⏻ icon in the top right to exit the controller.

For Technician level access to higher level settings or other assistance, please contact Killion Industries Parts and Service Department at 1-800-421-5352 or parts.service@killionindustries.com.